

# RIVERBANK ACOUSTICAL LABORATORIES

1512 S. BATAVIA AVENUE  
GENEVA, ILLINOIS 60134

Alion Science and Technology

630/232-0104  
FOUNDED 1918 BY  
WALLACE CLEMENT SABINE

## TEST REPORT

FOR: Verco Decking, Inc.  
Phoenix, AZ

Sound Absorption  
RAL™-A13-245

CONDUCTED: 22 August 2013

Page 1 of 7

ON: #13 W3CD Pan Metal Deck - 1.5pcf Fiberglass Insulation 5.25"x1.5" over 2" Poly ISO Board

### TEST METHOD

The test method conformed explicitly with the requirements of the ASTM Standard Test Method for Sound Absorption and Sound Absorption Coefficients by the Reverberation Room Method: ASTM C423-09a and E795-05. Riverbank Acoustical Laboratories has been accredited by the U.S. Department of Commerce, National Institute of Standards and Technology (NIST) under the National Voluntary Laboratory Accreditation Program (NVLAP) for this test procedure (NVLAP Lab Code: 100227-0). A description of the measuring procedure and room qualifications is available separately.

### DESCRIPTION OF THE SPECIMEN

The test specimen was designated by the manufacturer as #13 W3CD Pan Metal Deck - 1.5pcf Fiberglass Insulation 5.25"x1.5" over 2" Poly ISO Board. A visual inspection by Riverbank staff verified the manufacturer's description, further disclosing a cellular metal deck profile with solid fluted top section and perforated bottom pan. The two elements were shipped loose and assembled with screws. Strips of un-encapsulated 1.5 pcf fiberglass insulation (5.25 in. wide by 1.5 in. thick) were inserted into the entire length of each cell. The entire metal deck specimen was backed by 2 inch thick polyisocyanurate roof board (dense foam panels with reinforced felt facing).

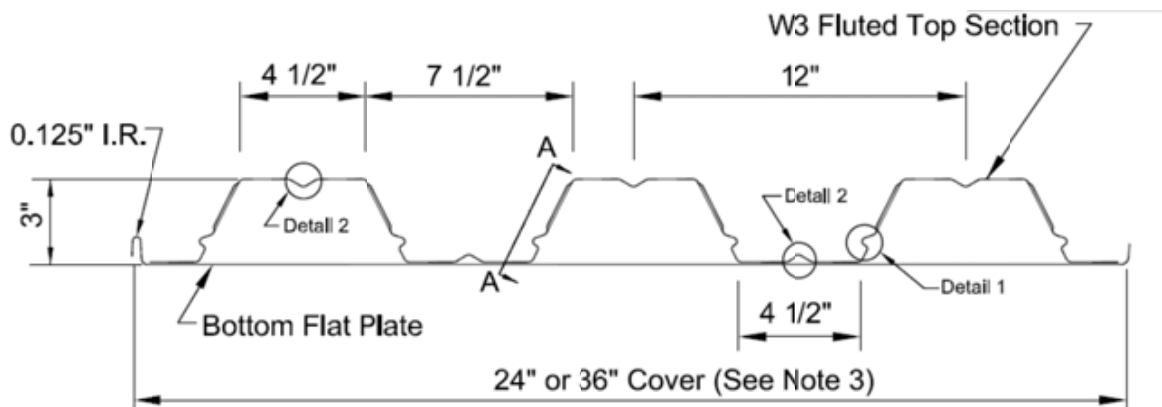


Figure 1 - Metal deck section drawing (supplied by client).



NVLAP Lab Code 100227-0

ACCREDITED BY DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY ACCREDITATION PROGRAM FOR SELECTED TEST METHODS FOR ACOUSTICS. THE LABORATORY'S ACCREDITATION OR ANY OF ITS TEST REPORTS IN NO WAY CONSTITUTES OR IMPLIES PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY NIST.

This report shall not be reproduced except in full, without the written approval of RAL.

THE RESULTS REPORTED ABOVE APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR MEASUREMENT. NO RESPONSIBILITY IS ASSUMED FOR PERFORMANCE OF ANY OTHER SPECIMEN.

# RIVERBANK ACOUSTICAL LABORATORIES

1512 S. BATAVIA AVENUE  
GENEVA, ILLINOIS 60134

Alion Science and Technology

630/232-0104  
FOUNDED 1918 BY  
WALLACE CLEMENT SABINE

## TEST REPORT

Verco Decking, Inc.  
22 August 2013

RAL™-A13-245  
Page 2 of 7

The specimen consisted of 3 pieces laid as a single rectangular patch. The overall dimensions of the specimen as measured were 2.74 m (108.00 in.) wide by 2.44 m (96.00 in.) long and 127.00 mm (5.00 in.) thick. The area used in the calculations was 6.69 m<sup>2</sup> (72.00 ft<sup>2</sup>). The weight of the entire specimen as measured was 140.73 kg (310.25 lbs), an average of 21.04 kg/m<sup>2</sup> (4.31 lbs/ft<sup>2</sup>).

The specimen was tested in the laboratory's 292.0 m<sup>3</sup> (10,311.0 ft<sup>3</sup>) test chamber. The room temperature at the time of the test was 22±0°C (71±0°F) and 62±0% relative humidity. The barometric pressure was 742 mm of mercury.

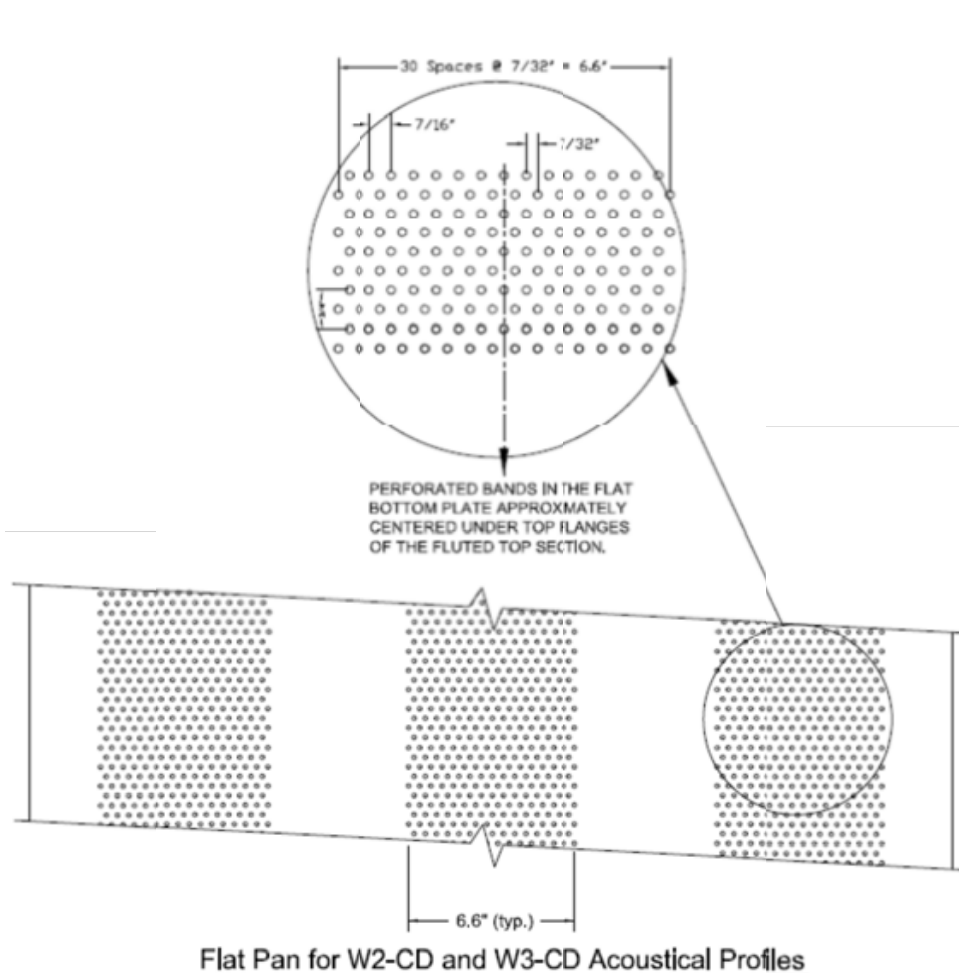


Figure 2 - Acoustical perforation detail (supplied by client).



NVLAP Lab Code 100227-0

ACCREDITED BY DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY ACCREDITATION LABORATORY  
ACCREDITATION PROGRAM FOR SELECTED TEST METHODS FOR ACOUSTICS.  
THE LABORATORY'S ACCREDITATION OR ANY OF ITS TEST REPORTS IN NO WAY CONSTITUTES  
OR IMPLIES PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY NIST.

This report shall not be reproduced except in full, without the written approval of RAL.

THE RESULTS REPORTED ABOVE APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR MEASUREMENT. NO RESPONSIBILITY IS ASSUMED FOR PERFORMANCE OF ANY OTHER SPECIMEN.

# RIVERBANK ACOUSTICAL LABORATORIES

1512 S. BATAVIA AVENUE  
GENEVA, ILLINOIS 60134

Alion Science and Technology

630/232-0104  
FOUNDED 1918 BY  
WALLACE CLEMENT SABINE

## TEST REPORT

Verco Decking, Inc.  
22 August 2013

**RAL™-A13-245**  
Page 3 of 7



Figure 3 - Specimen mounted in the test chamber.



Figure 4 - Detail of the test specimen.



NVLAP Lab Code 100227-0

**ACCREDITED BY DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY  
ACCREDITATION PROGRAM FOR SELECTED TEST METHODS FOR ACOUSTICS.  
THE LABORATORY'S ACCREDITATION OR ANY OF ITS TEST REPORTS IN NO WAY CONSTITUTES  
OR IMPLIES PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY NIST.**

This report shall not be reproduced except in full, without the written approval of RAL.

THE RESULTS REPORTED ABOVE APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR MEASUREMENT. NO RESPONSIBILITY IS ASSUMED FOR PERFORMANCE OF ANY OTHER SPECIMEN.

# RIVERBANK ACOUSTICAL LABORATORIES

1512 S. BATAVIA AVENUE  
GENEVA, ILLINOIS 60134

Alion Science and Technology

630/232-0104  
FOUNDED 1918 BY  
WALLACE CLEMENT SABINE

## TEST REPORT

Verco Decking, Inc.  
22 August 2013

RAL™-A13-245  
Page 4 of 7

### MOUNTING A

The test specimen was laid directly against the test surface. The perimeter was sealed using wood and metal framing.

### TEST RESULTS

1/3 Octave Center Frequency (Hz)	Absorption Coefficient	Total Absorption In Sabins
100	0.41	29.23
** 125	0.50	35.65
160	0.70	50.58
200	0.70	50.25
** 250	0.77	55.29
315	0.70	50.49
400	0.88	63.56
** 500	0.98	70.91
630	0.97	70.06
800	0.87	62.72
** 1000	0.77	55.79
1250	0.74	53.25
1600	0.64	45.95
** 2000	0.62	44.56
2500	0.61	43.78
3150	0.55	39.89
** 4000	0.50	36.23
5000	0.44	31.60

**SAA = 0.77**

**NRC = 0.80**



NVLAP Lab Code 100227-0

ACCREDITED BY DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY  
ACCREDITATION PROGRAM FOR SELECTED TEST METHODS FOR ACOUSTICS.  
THE LABORATORY'S ACCREDITATION OR ANY OF ITS TEST REPORTS IN NO WAY CONSTITUTES  
OR IMPLIES PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY NIST.

This report shall not be reproduced except in full, without the written approval of RAL.

THE RESULTS REPORTED ABOVE APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR MEASUREMENT. NO RESPONSIBILITY IS ASSUMED FOR PERFORMANCE OF ANY OTHER SPECIMEN.

# RIVERBANK ACOUSTICAL LABORATORIES

1512 S. BATAVIA AVENUE  
GENEVA, ILLINOIS 60134

Alion Science and Technology

630/232-0104  
FOUNDED 1918 BY  
WALLACE CLEMENT SABINE

## TEST REPORT

Verco Decking, Inc.  
22 August 2013

RAL™-A13-245  
Page 5 of 7

### TEST RESULTS (Continued)

The sound absorption average (SAA) is defined as a single number rating, the average, rounded to the nearest 0.01, of the sound absorption coefficient of a material for the twelve one-third octave bands from 200 through 2500 Hz, inclusive.

The noise reduction coefficient (NRC) is defined from previous versions of this same test method as the average of the coefficients at 250, 500, 1000, and 2000 Hz, expressed to the nearest integral multiple of 0.05.

Tested by *Marc Sciaky* Approved by \_\_\_\_\_  
Marc Sciaky  
Experimentalist  
Eric P. Wolfram  
Laboratory Manager



NVLAP Lab Code 100227-0

ACCREDITED BY DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY  
ACCREDITATION PROGRAM FOR SELECTED TEST METHODS FOR ACOUSTICS.  
THE LABORATORY'S ACCREDITATION OR ANY OF ITS TEST REPORTS IN NO WAY CONSTITUTES  
OR IMPLIES PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY NIST.

This report shall not be reproduced except in full, without the written approval of RAL.

THE RESULTS REPORTED ABOVE APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR MEASUREMENT. NO RESPONSIBILITY IS ASSUMED FOR PERFORMANCE OF ANY OTHER SPECIMEN.

# RIVERBANK ACOUSTICAL LABORATORIES

1512 S. BATAVIA AVENUE  
GENEVA, ILLINOIS 60134

Alion Science and Technology

630/232-0104  
FOUNDED 1918 BY  
WALLACE CLEMENT SABINE


## TEST REPORT

Verco Decking, Inc.  
22 August 2013

RAL™-A13-245  
Page 6 of 7

### SOUND ABSORPTION REPORT

#13 W3CD Pan Metal Deck - 1.5pcf Fiberglass Insulation 5.25"x1.5" over 2" Poly  
ISO Board

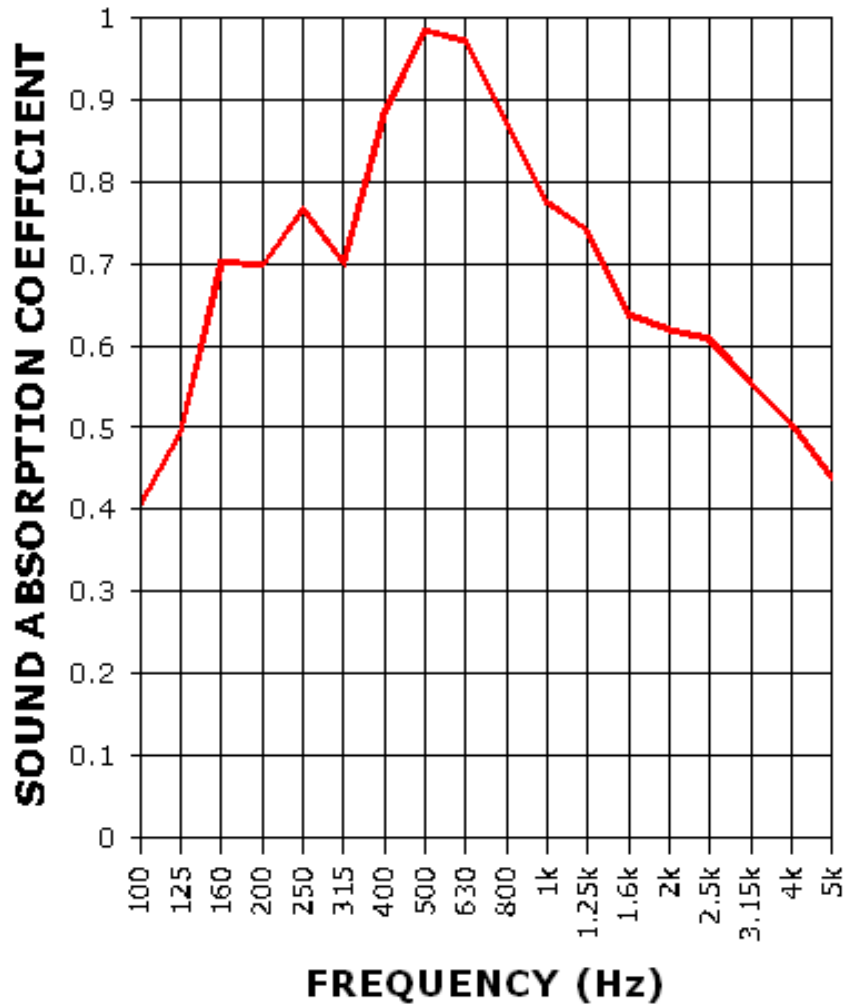

**SAA = 0.77**  
**NRC = 0.80**



NVLAP Lab Code 100227-0

ACCREDITED BY DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY  
ACCREDITATION PROGRAM FOR SELECTED TEST METHODS FOR ACOUSTICS.  
THE LABORATORY'S ACCREDITATION OR ANY OF ITS TEST REPORTS IN NO WAY CONSTITUTES  
OR IMPLIES PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY NIST.

This report shall not be reproduced except in full, without the written approval of RAL.

THE RESULTS REPORTED ABOVE APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR MEASUREMENT. NO RESPONSIBILITY IS ASSUMED FOR PERFORMANCE OF ANY OTHER SPECIMEN.

# RIVERBANK ACOUSTICAL LABORATORIES

1512 S. BATAVIA AVENUE  
GENEVA, ILLINOIS 60134

Alion Science and Technology

630/232-0104  
FOUNDED 1918 BY  
WALLACE CLEMENT SABINE

## TEST REPORT

Verco Decking, Inc.  
22 August 2013

RAL™-A13-245  
Page 7 of 7

### Appendix to ASTM C423 Sound Absorption Test **Extended Frequency Range Data**

Product Description: #13 W3CD Pan Metal Deck - 1.5pcf Fiberglass Insulation 5.25"x1.5" over 2" Poly ISO Board (See Full Report)

Riverbank Acoustical Laboratories is accredited to perform sound absorption coefficient measurements for the frequency range of 100Hz to 5,000Hz. However, we calculate sound absorption values at additional test frequencies as a service to our clients.

Although these measurements were made in accordance with the procedures described in ASTM C423-09a, they do not qualify as part of the standard. Since the results are representative of the test environment only, they are unofficial and intended for research and development guidelines rather than for commercial purposes. The sound absorption values at additional frequencies were as follows:

#### RAL-A13-245

1/3 Octave Center Frequency (Hz)	<u>Absorption</u> <u>Coefficient</u>	<b>Total Absorption</b> (Sabins)
40	0.04	2.90
50	-0.03	-2.13
63	0.08	5.76
80	0.07	5.12
6300	0.43	30.75
8000	0.52	37.30
10000	0.58	41.87



NVLAP Lab Code 100227-0

ACCREDITED BY DEPARTMENT OF COMMERCE, NATIONAL VOLUNTARY LABORATORY  
ACCREDITATION PROGRAM FOR SELECTED TEST METHODS FOR ACOUSTICS.  
THE LABORATORY'S ACCREDITATION OR ANY OF ITS TEST REPORTS IN NO WAY CONSTITUTES  
OR IMPLIES PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY NIST.

This report shall not be reproduced except in full, without the written approval of RAL.

THE RESULTS REPORTED ABOVE APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR MEASUREMENT. NO RESPONSIBILITY IS ASSUMED FOR PERFORMANCE OF ANY OTHER SPECIMEN.