

Test Report

SPONSOR: **Vulcraft-Verco Group**
Norfolk, NE

Sound Absorption
RAL™-A19-102

CONDUCTED: 2019-03-12

Page 1 of 10

ON: Roof Deck Assembly - 2.0DA, plastic mesh, 3.0 pcf encapsulated fiberglass insulation, DensDeck

TEST METHODOLOGY

Riverbank Acoustical Laboratories™ is accredited by the U.S. Department of Commerce, National Institute of Standards and Technology (NIST) under the National Voluntary Laboratory Accreditation Program (NVLAP) as an ISO 17025:2005 Laboratory (NVLAP Lab Code: 100227-0) and for this test procedure. The test reported in this document conformed explicitly with ASTM C423-17: "Standard Test Method for Sound Absorption and Sound Absorption Coefficients by the Reverberation Room Method." The specimen mounting was performed according to ASTM E795-16: "Standard Practices for Mounting Test Specimens During Sound Absorption Tests." A description of the measurement procedure and room specifications are available upon request. The results presented in this report apply to the sample as received from the test sponsor.

INFORMATION PROVIDED BY SPONSOR

The test specimen was designated by the sponsor as Roof Deck Assembly - 2.0DA, plastic mesh, 3.0 pcf encapsulated fiberglass insulation, DensDeck. The following nominal product information was provided by the sponsor prior to testing. The accuracy of such sponsor-provided information can affect the validity of the test results.

Product Under Test

Corrugated Metal

Designation: 2.0DA

Manufacturer: Vulcraft-Verco Group

Insulation

Density: 48.1 kg/m³ (3.0 lbs/ft³)

SPECIMEN MEASUREMENTS & TEST CONDITIONS

Through a full internal inspection performed on the test specimen, Riverbank personnel verified the following information:

Roofing Board

Trade Name: DensDeck

Materials: Gypsum board with glass mat facing

Dimensions: 4 @ 1219.2 mm (48 in.) x 1219.2 mm (48 in.)
2 @ 1219.2 mm (48 in.) x 304.8 mm (12 in.)

Thickness: 12.7 mm (0.5 in.)

Overall Weight: 69.85 kg (154 lbs)

Mass per Unit Area: 10.44 kg/m² (2.14 lbs/ft²)

1512 S BATAVIA AVENUE
GENEVA, IL 60134
630-232-0104

An  ALION Technical Center

RIVERBANK.ALIONSCIENCE.COM

FOUNDED 1918 BY
WALLACE CLEMENT SABINE

Test Report

Vulcraft-Verco Group
2019-03-12

RAL™-A19-102

Page 2 of 10

Insulation

Materials: Fiberglass insulation, encapsulated in polyethylene bags
Dimensions: 16 @ 2743.2 mm (108 in.) x 120.65 mm (4.75 in.)
Thickness: 50.8 mm (2 in.)
Installation: Inserted in ribs of corrugated metal (see below)
Overall Weight: 12.81 kg (28.25 lbs)

Corrugated Metal

Dimensions: 4 @ 647.7 mm (25.5 in.) x 2743.2 mm (108 in.)
Depth: 50.8 mm (2 in.)
Metal Thickness: 0.79 mm (0.031 in.)
Top Rib Opening: 25.4 mm (1 in.)
Bottom Rib Opening: 34.92 mm (1.375 in.)
Pitch: 157.23 mm (6.19 in.)
Perforations: Long flanges perforated
Circular holes @ 3.96 mm (0.156 in.) diameter
Triangular pitch @ 9.52 mm (0.375 in.) on center
Approximately 15.7 % open area
Installation: Loose laid over roofing board, perforations exposed to sound field
Joints overlapped at short flange, no fasteners
Overall Weight: 69.17 kg (152.5 lbs)

Plastic Mesh

Material: Plastic fibers bonded in square mesh
Dimensions: 13 @ 2743.2 mm (108 in.) x 127 mm (5 in.)
Thickness: 2.54 mm (0.1 in.)
Spacing: 1.5 mm (0.059 in.) thick fibers spaced 8.5 mm (0.335 in.) on center
Installation: Inserted between insulation and perforated metal flanges
Overall Weight: 1.81 kg (4 lbs)

1512 S BATAVIA AVENUE
GENEVA, IL 60134
630-232-0104

An ALION Technical Center

RIVERBANK.ALIONSCIENCE.COM

FOUNDED 1918 BY
WALLACE CLEMENT SABINE

Test Report

Vulcraft-Verco Group
2019-03-12

RAL™-A19-102

Page 3 of 10

Overall Specimen Properties

Size: 2.74 m (108.0 in) wide by 2.5 m (98.5 in) long
Thickness: 0.06 m (2.5 in)
Weight: 153.65 kg (338.75 lbs)
Mass per Unit Area: 22.39 kg/m² (4.59 lbs/ft²)
Calculation Area: 6.864 m² (73.88 ft²)

Test Environment

Room Volume: 291.98 m³
Temperature: 21.4 °C ± 0.1 °C (Requirement: ≥ 10 °C and ≤ 5 °C change)
Relative Humidity: 67.45 % ± 0.7 % (Requirement: ≥ 40 % and ≤ 5 % change)
Barometric Pressure: 99.7 kPa (Requirement not defined)

MOUNTING METHOD

Type A Mounting: The test specimen was laid directly against the test surface. Perimeter edges were sealed with wood, metal framing, and tape.

1512 S BATAVIA AVENUE
GENEVA, IL 60134
630-232-0104

An **ALION** Technical Center

RIVERBANK.ALIONSCIENCE.COM

FOUNDED 1918 BY
WALLACE CLEMENT SABINE

Test Report

Vulcraft-Verco Group
2019-03-12

RAL™-A19-102
Page 4 of 10



Figure 1 – Specimen mounted in test chamber



Figure 2 – Detail of specimen composition

1512 S BATAVIA AVENUE
GENEVA, IL 60134
630-232-0104

An **ALION** Technical Center

RIVERBANK.ALIONSCIENCE.COM

FOUNDED 1918 BY
WALLACE CLEMENT SABINE

Test Report

Vulcraft-Verco Group
2019-03-12

RAL™-A19-102
Page 5 of 10



Figure 3 – Plastic mesh installed over perforated flanges

1512 S BATAVIA AVENUE
 GENEVA, IL 60134
 630-232-0104

An ALION Technical Center

RIVERBANK.ALIONSCIENCE.COM

FOUNDED 1918 BY
 WALLACE CLEMENT SABINE

Test Report

Vulcraft-Verco Group
 2019-03-12

RAL™-A19-102

Page 6 of 10

TEST RESULTS

Specimen total absorption and absorption coefficient are tabulated at the eighteen standard frequencies. A graphic presentation of the data and additional information appear on the following pages.

1/3 Octave Center Frequency (Hz)	Total Absorption (m ²)	Total Absorption (Sabins)	Absorption Coefficient
100	1.55	16.63	0.23
** 125	2.03	21.84	0.30
160	2.38	25.61	0.35
200	3.02	32.49	0.44
** 250	3.88	41.71	0.56
315	5.13	55.20	0.75
400	6.14	66.04	0.89
** 500	6.97	75.03	1.02
630	7.13	76.72	1.04
800	7.15	76.93	1.04
** 1000	6.81	73.31	0.99
1250	6.24	67.19	0.91
1600	6.32	68.05	0.92
** 2000	6.31	67.90	0.92
2500	6.04	65.02	0.88
3150	5.83	62.72	0.85
** 4000	5.37	57.81	0.78
5000	4.69	50.52	0.68

SAA = 0.86
NRC = 0.85

1512 S BATAVIA AVENUE
GENEVA, IL 60134
630-232-0104

An ALION Technical Center

RIVERBANK.ALIONSCIENCE.COM

FOUNDED 1918 BY
WALLACE CLEMENT SABINE

Test Report


Vulcraft-Verco Group
2019-03-12

RAL™-A19-102
Page 7 of 10


TEST RESULTS (continued)

The sound absorption average (SAA) is defined in ASTM C423-17 Section 3.1.1 as the arithmetic average of the sound absorption coefficients of a material for the twelve one-third octave bands from 200 Hz through 2500 Hz, inclusive, rounded to the nearest integer multiple of 0.01.

The noise reduction coefficient (NRC) is defined from previous versions of ASTM C423 as the arithmetic average of the sound absorption coefficients at 250 Hz, 500 Hz, 1000 Hz, and 2000 Hz, rounded to the nearest integer multiple of 0.05.

Tested by 
Marc Sciaky
Senior Experimentalist

Report by 
Malcolm Kelly
Acoustical Test Engineer

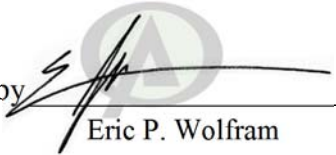Approved by 
Eric P. Wolfram
Laboratory Manager

1512 S BATAVIA AVENUE
GENEVA, IL 60134
630-232-0104

An ALION Technical Center

RIVERBANK.ALIONSCIENCE.COM

FOUNDED 1918 BY
WALLACE CLEMENT SABINE


Test Report

Vulcraft-Verco Group
2019-03-12

RAL™-A19-102
Page 8 of 10

SOUND ABSORPTION REPORT

Roof Deck Assembly - 2.0DA, plastic mesh, 3.0 pcf encapsulated fiberglass insulation,
DensDeck

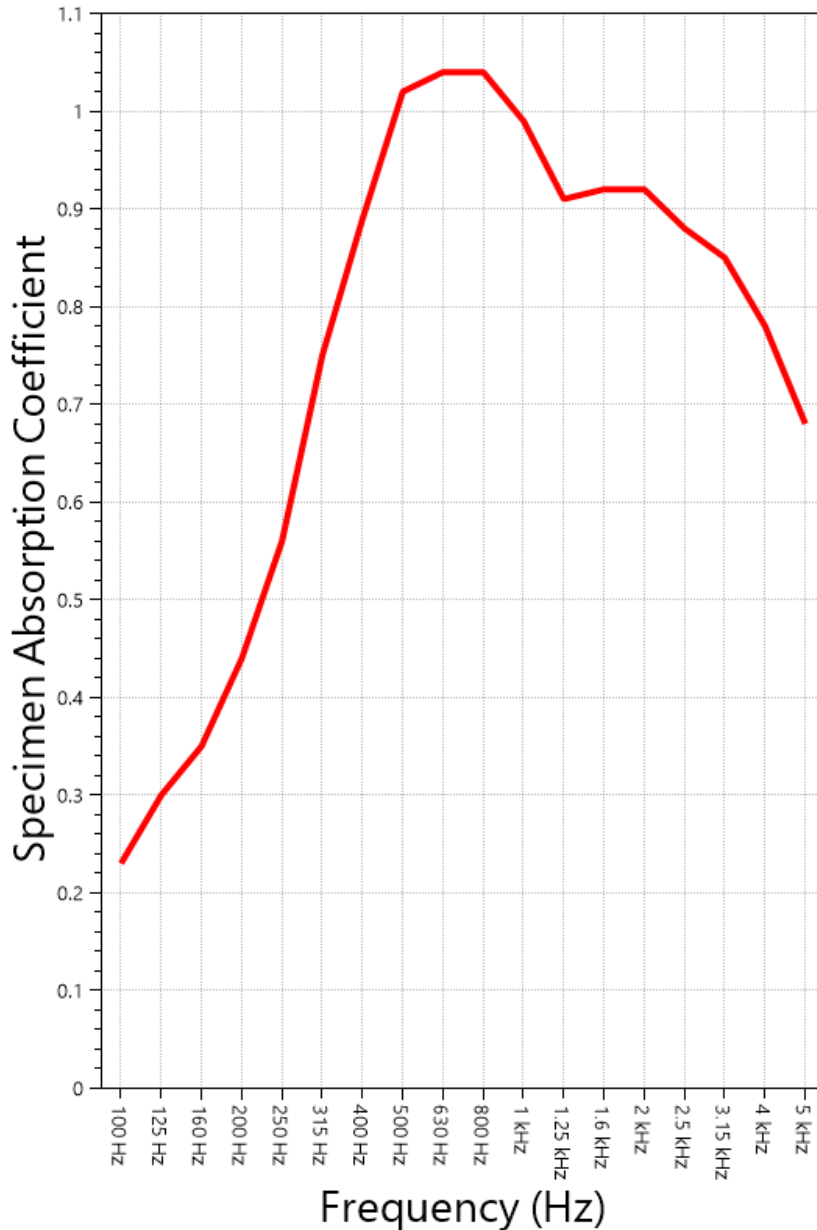

SAA = 0.86
NRC = 0.85



RIVERBANK ACOUSTICAL LABORATORIES IS ACCREDITED BY NVLAP (LAB CODE 100227-0) FOR ACOUSTICAL TESTING SERVICES IN ACCORDANCE WITH ISO/IEC 17025:2005 AND FOR THIS PROCEDURE. THIS REPORT MUST NOT BE USED BY THE CLIENT TO CLAIM PRODUCT CERTIFICATION, APPROVAL, OR ENDORSEMENT BY RAL, NVLAP, NIST, OR ANY AGENCY OF THE U.S. GOVERNMENT. THIS REPORT SHALL NOT BE MODIFIED WITHOUT THE WRITTEN APPROVAL OF RAL. THE RESULTS REPORTED APPLY ONLY TO THE SPECIFIC SAMPLE SUBMITTED FOR TESTING; RAL ASSUMES NO RESPONSIBILITY FOR THE PERFORMANCE OF ANY OTHER SAMPLE.

1512 S BATAVIA AVENUE
 GENEVA, IL 60134
 630-232-0104

An ALION Technical Center

RIVERBANK.ALIONSCIENCE.COM

FOUNDED 1918 BY
 WALLACE CLEMENT SABINE

Test Report

Vulcraft-Verco Group
 2019-03-12

RAL™-A19-102

Page 9 of 10

APPENDIX A: Extended Frequency Range Data

Specimen: Roof Deck Assembly - 2.0DA, plastic mesh, 3.0 pcf encapsulated fiberglass insulation, DensDeck (See Full Report)

The following non-accredited data were obtained in accordance with ASTM C423-17, but extend beyond the defined frequency range of 100Hz to 5,000Hz. These unofficial results are representative of the RAL test environment only and intended for research & comparison purposes.

1/3 Octave Band Center Frequency (Hz)	Total Absorption (Sabins)	Absorption Coefficient
31.5	10.83	0.15
40	4.13	0.06
50	4.04	0.05
63	8.52	0.12
80	9.82	0.13
100	16.63	0.23
125	21.84	0.30
160	25.61	0.35
200	32.49	0.44
250	41.71	0.56
315	55.20	0.75
400	66.04	0.89
500	75.03	1.02
630	76.72	1.04
800	76.93	1.04
1000	73.31	0.99
1250	67.19	0.91
1600	68.05	0.92
2000	67.90	0.92
2500	65.02	0.88
3150	62.72	0.85
4000	57.81	0.78
5000	50.52	0.68
6300	47.27	0.64
8000	41.66	0.56
10000	43.12	0.58
12500	47.64	0.64

1512 S BATAVIA AVENUE
GENEVA, IL 60134
630-232-0104

An ALION Technical Center

RIVERBANK.ALIONSCIENCE.COM

FOUNDED 1918 BY
WALLACE CLEMENT SABINE

Test Report

Vulcraft-Verco Group
2019-03-12

RAL™-A19-102
Page 10 of 10

APPENDIX B: Instruments of Traceability

Specimen: Roof Deck Assembly - 2.0DA, plastic mesh, 3.0 pcf encapsulated fiberglass insulation, DensDeck (See Full Report)

<u>Description</u>	<u>Model</u>	<u>Serial Number</u>	<u>Date of Certification</u>	<u>Calibration Due</u>
System 1	Type 3160-A-042	3160-106968	2018-08-09	2019-08-09
Bruel & Kjaer Mic And Preamp A	Type 4943-B-001	2311428	2018-09-28	2019-09-28
Bruel & Kjaer Pistonphone	Type 4228	2781248	2018-08-06	2019-08-06
EXTECH Hygro 662	SD700	A083662	2018-11-29	2019-11-29

APPENDIX C: Revisions to Original Test Report

Specimen: Roof Deck Assembly - 2.0DA, plastic mesh, 3.0 pcf encapsulated fiberglass insulation, DensDeck (See Full Report)

<u>Date</u>	<u>Revision</u>
2019-06-06	Original report issued

END